


# Overflow Emergency Response Plan

12-1-2019


Albuquerque Bernalillo County Water Utility Authority

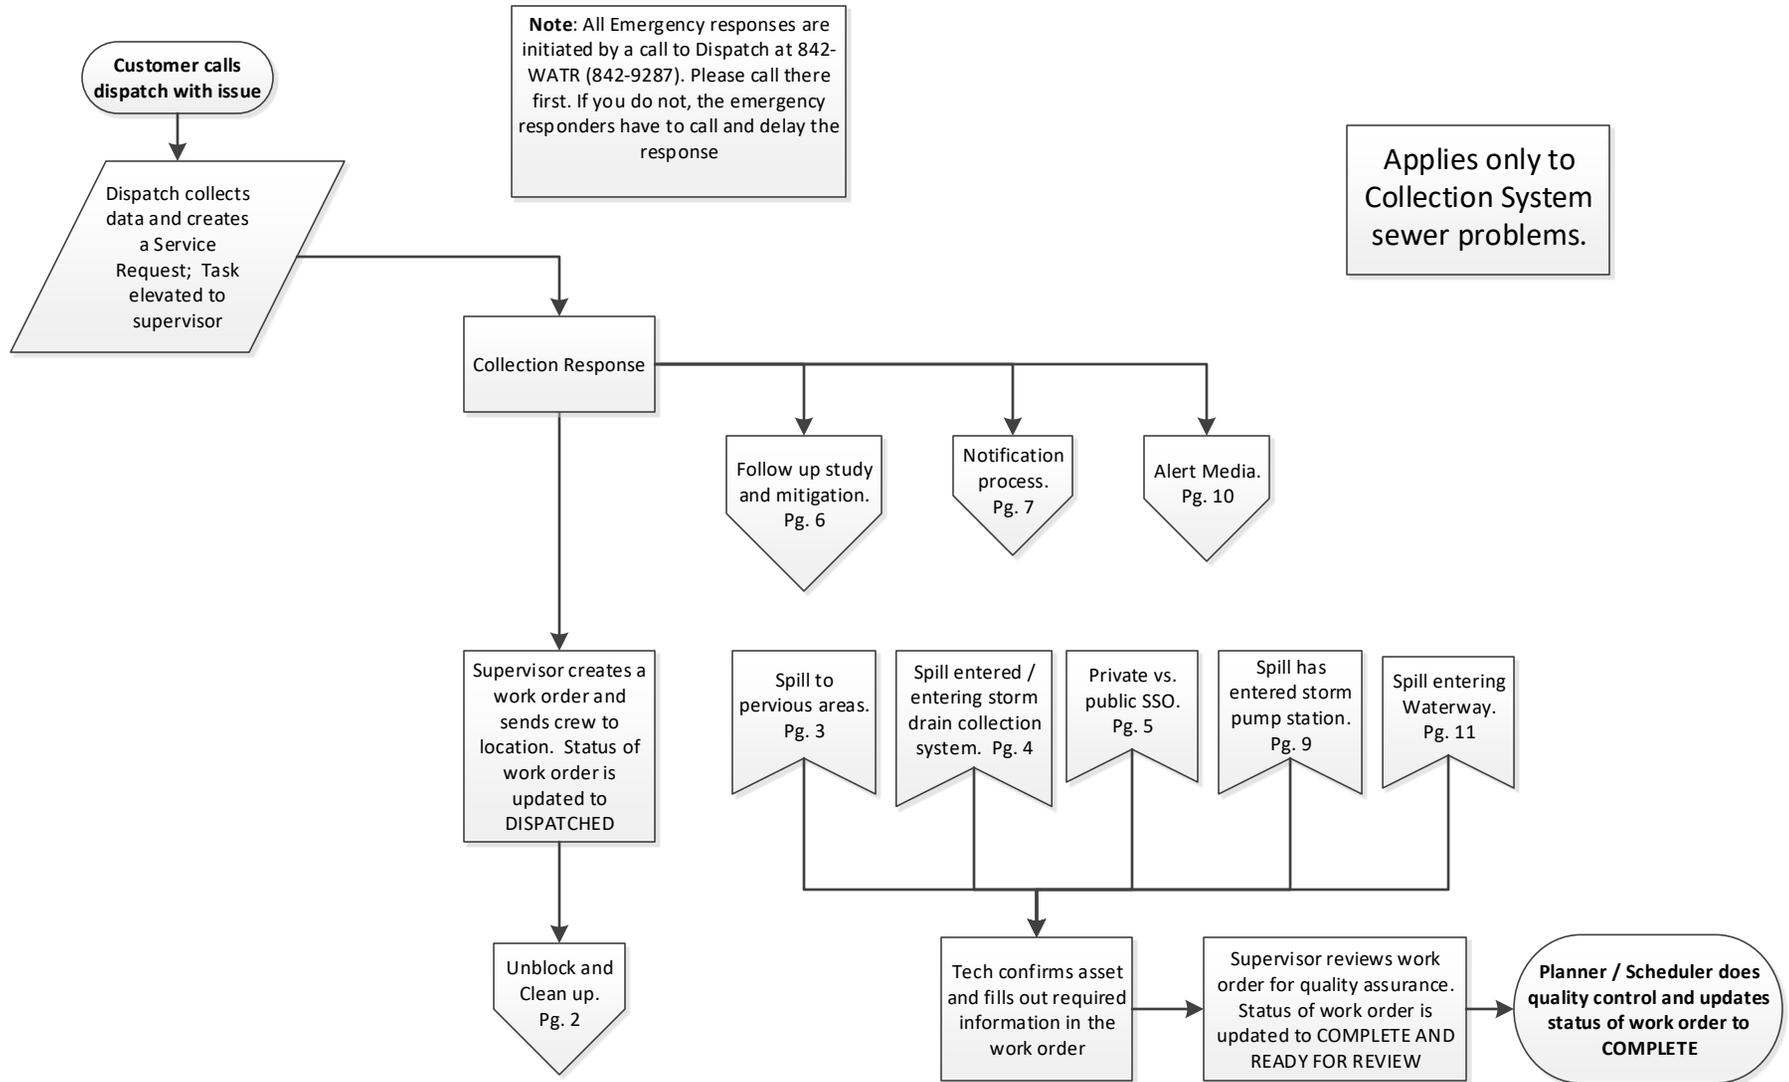


# Overflow Emergency Response Plan

12-1-2019

Albuquerque Bernalillo County Water Utility Authority

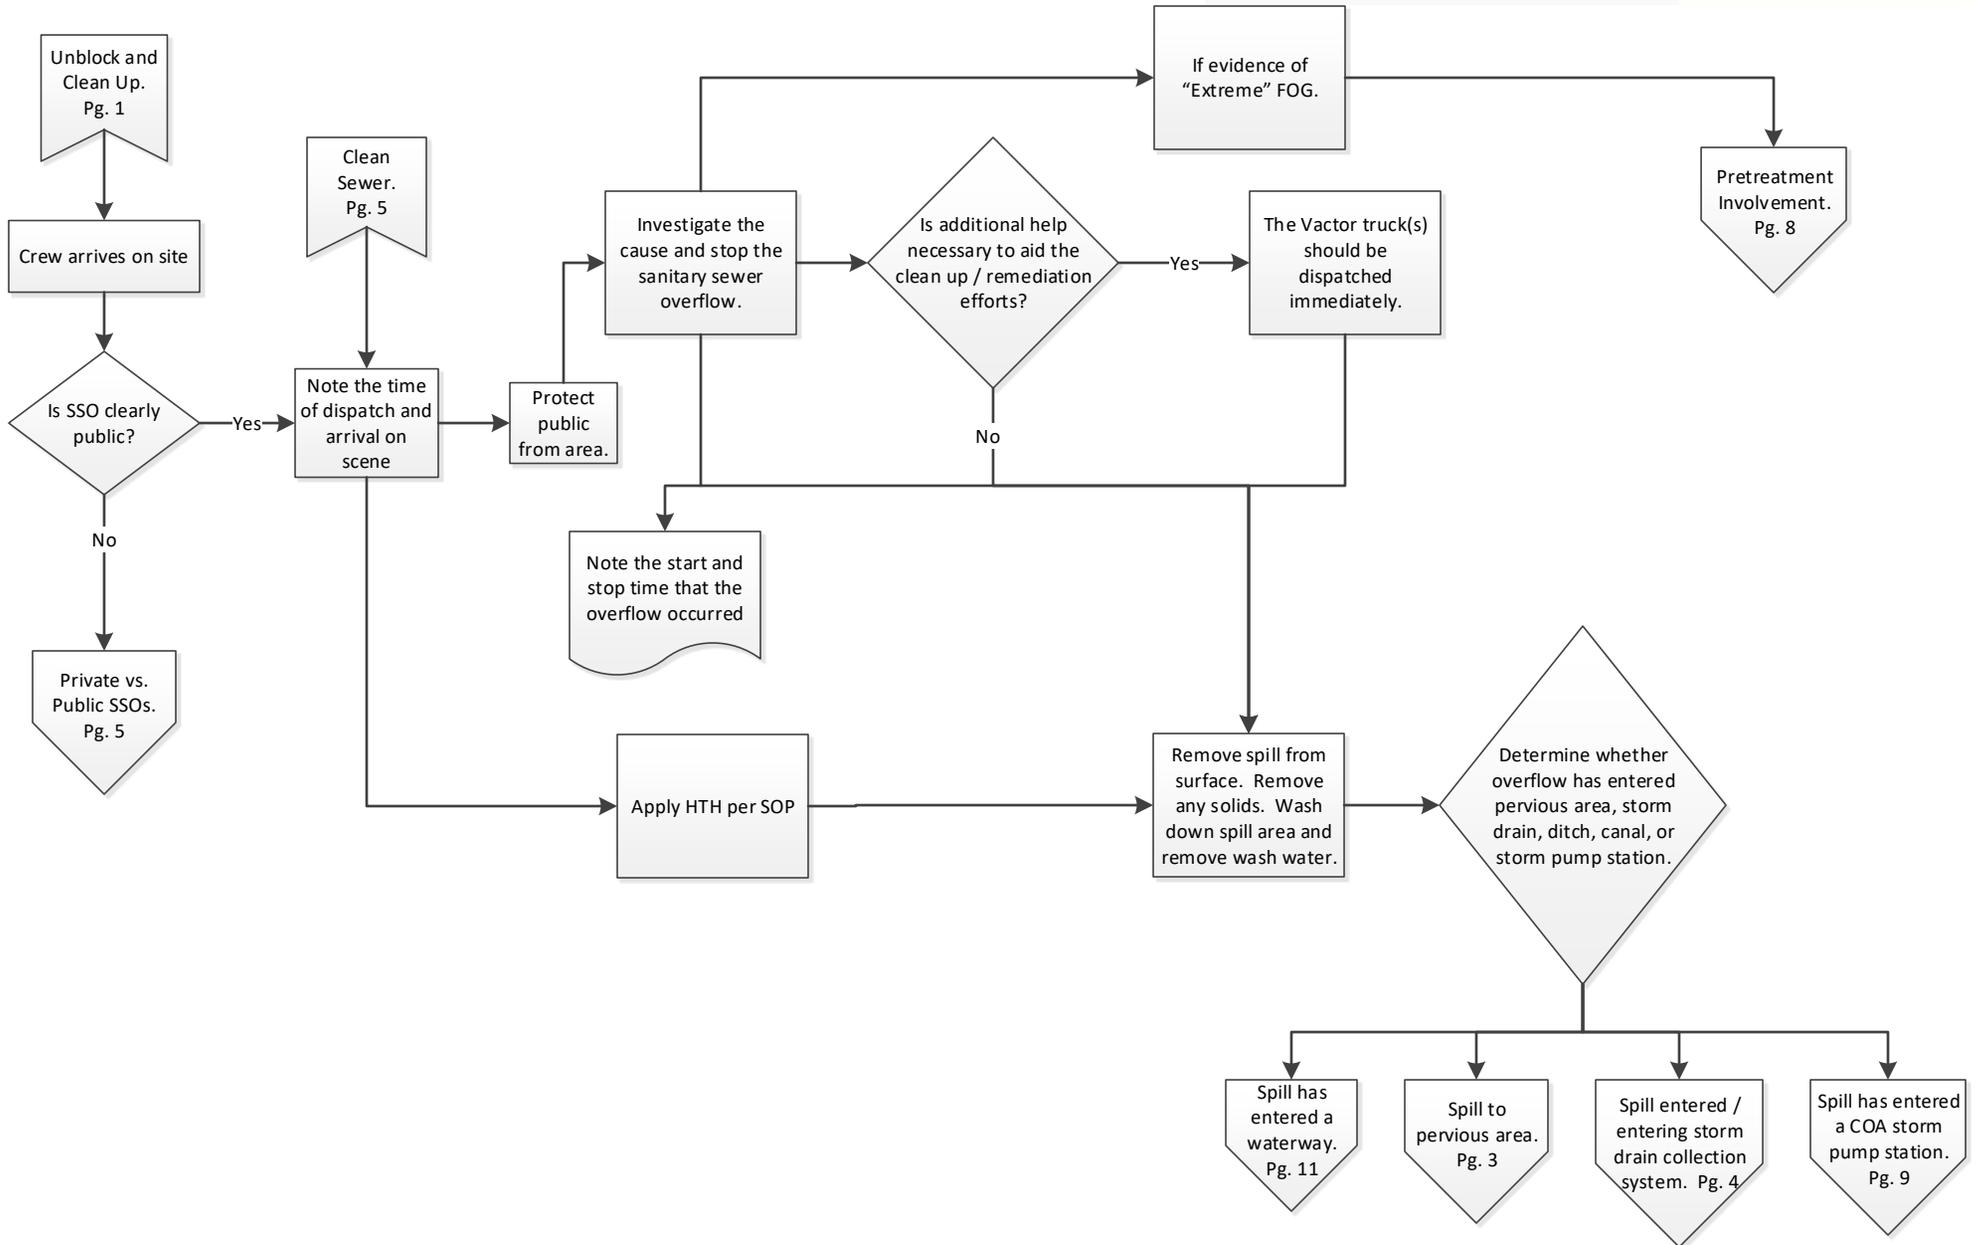


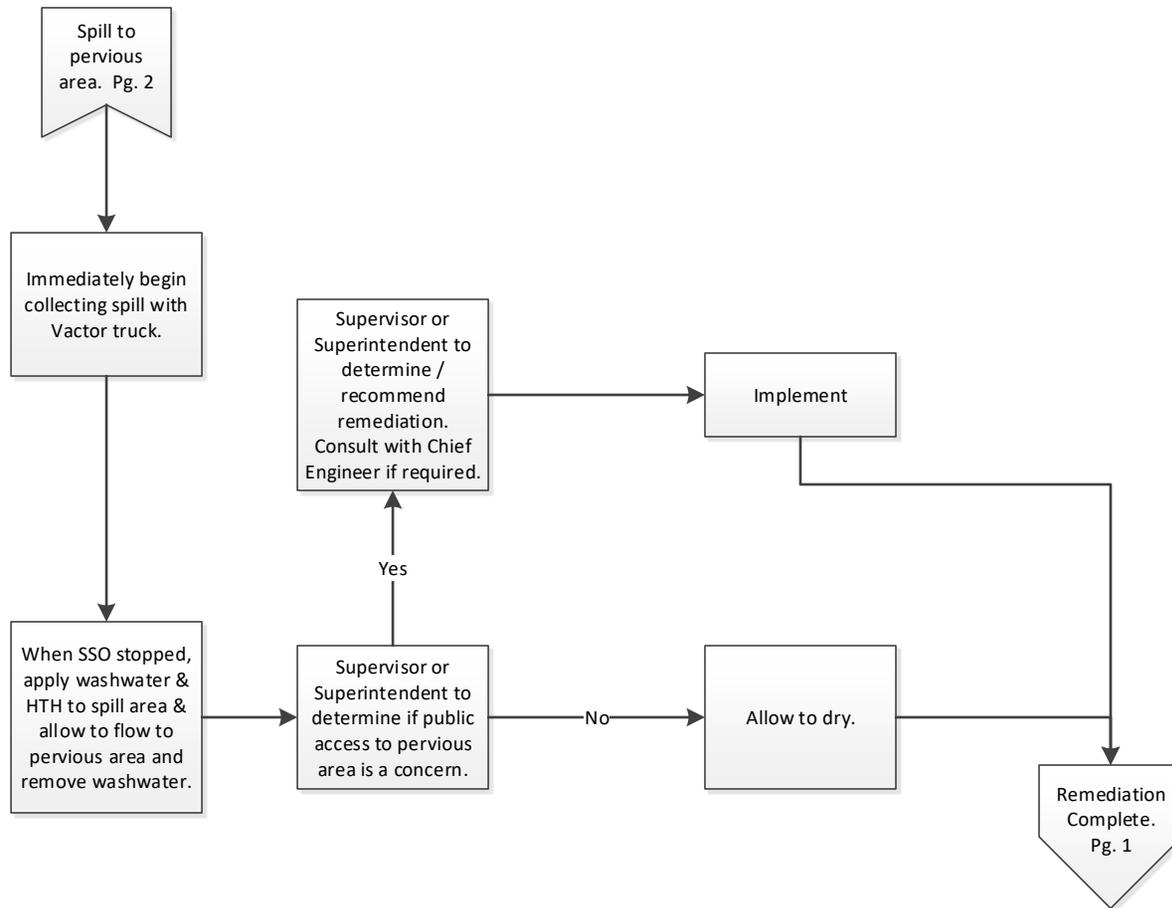

# Overflow Emergency Response Plan

12-1-2019

Albuquerque Bernalillo County Water Utility Authority

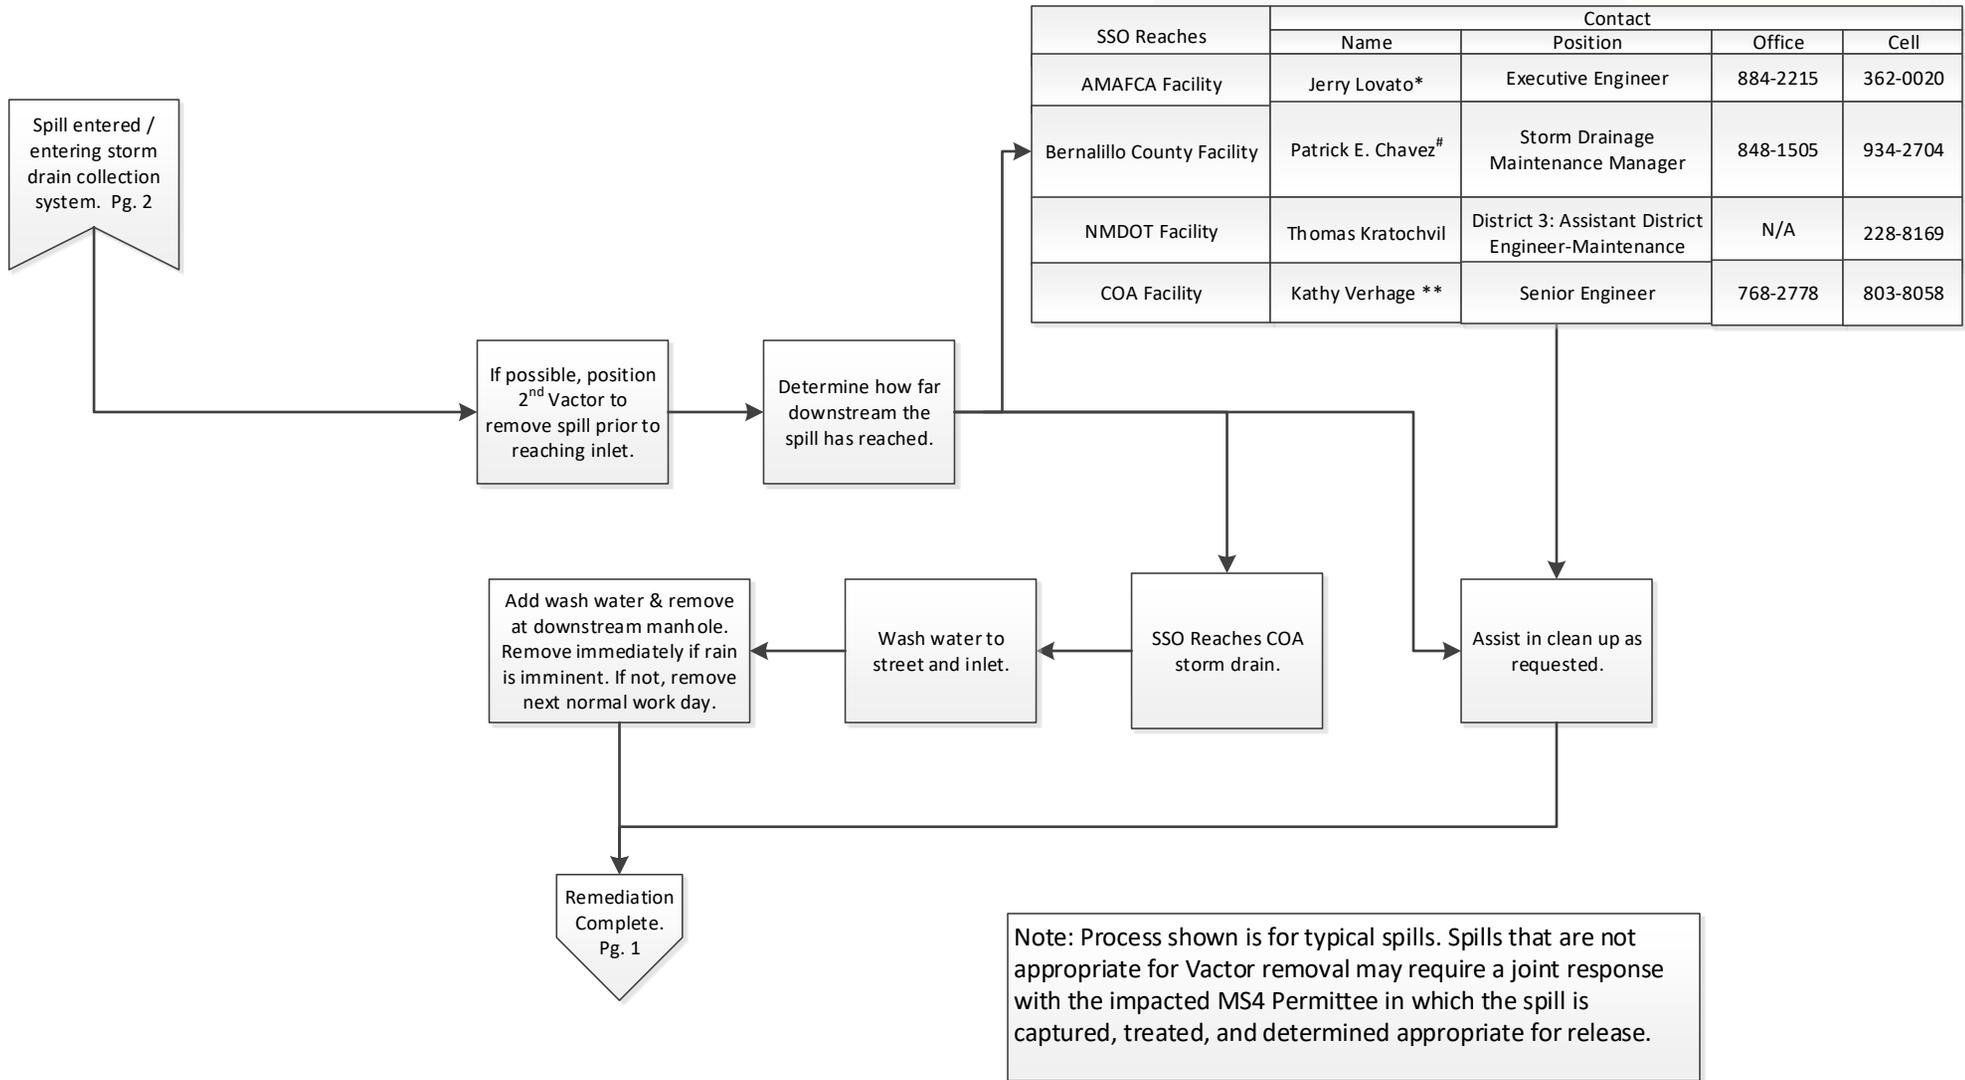

\*If Jerry Lovato is not immediately available, call:

Nolan Bennett: Field Engineer (505) 301-6941  
Sal Hernandez: Superintendent (505) 366-8209

\*\*If Kathy Verhage is not immediately available, call:

David Harrison: Engr. Div. Manager (505) 238-4158  
Carl Rinkenberger: O&M Manager (505) 250-4334  
Daniel Tapia: O&M Supt (505) 228-6874


#If Patrick E. Chavez is not immediately available, call:

Kali Bronson: Stormwater Program Compliance Manager (505) 401-1779

# Overflow Emergency Response Plan

12-1-2019


Albuquerque Bernalillo County Water Utility Authority

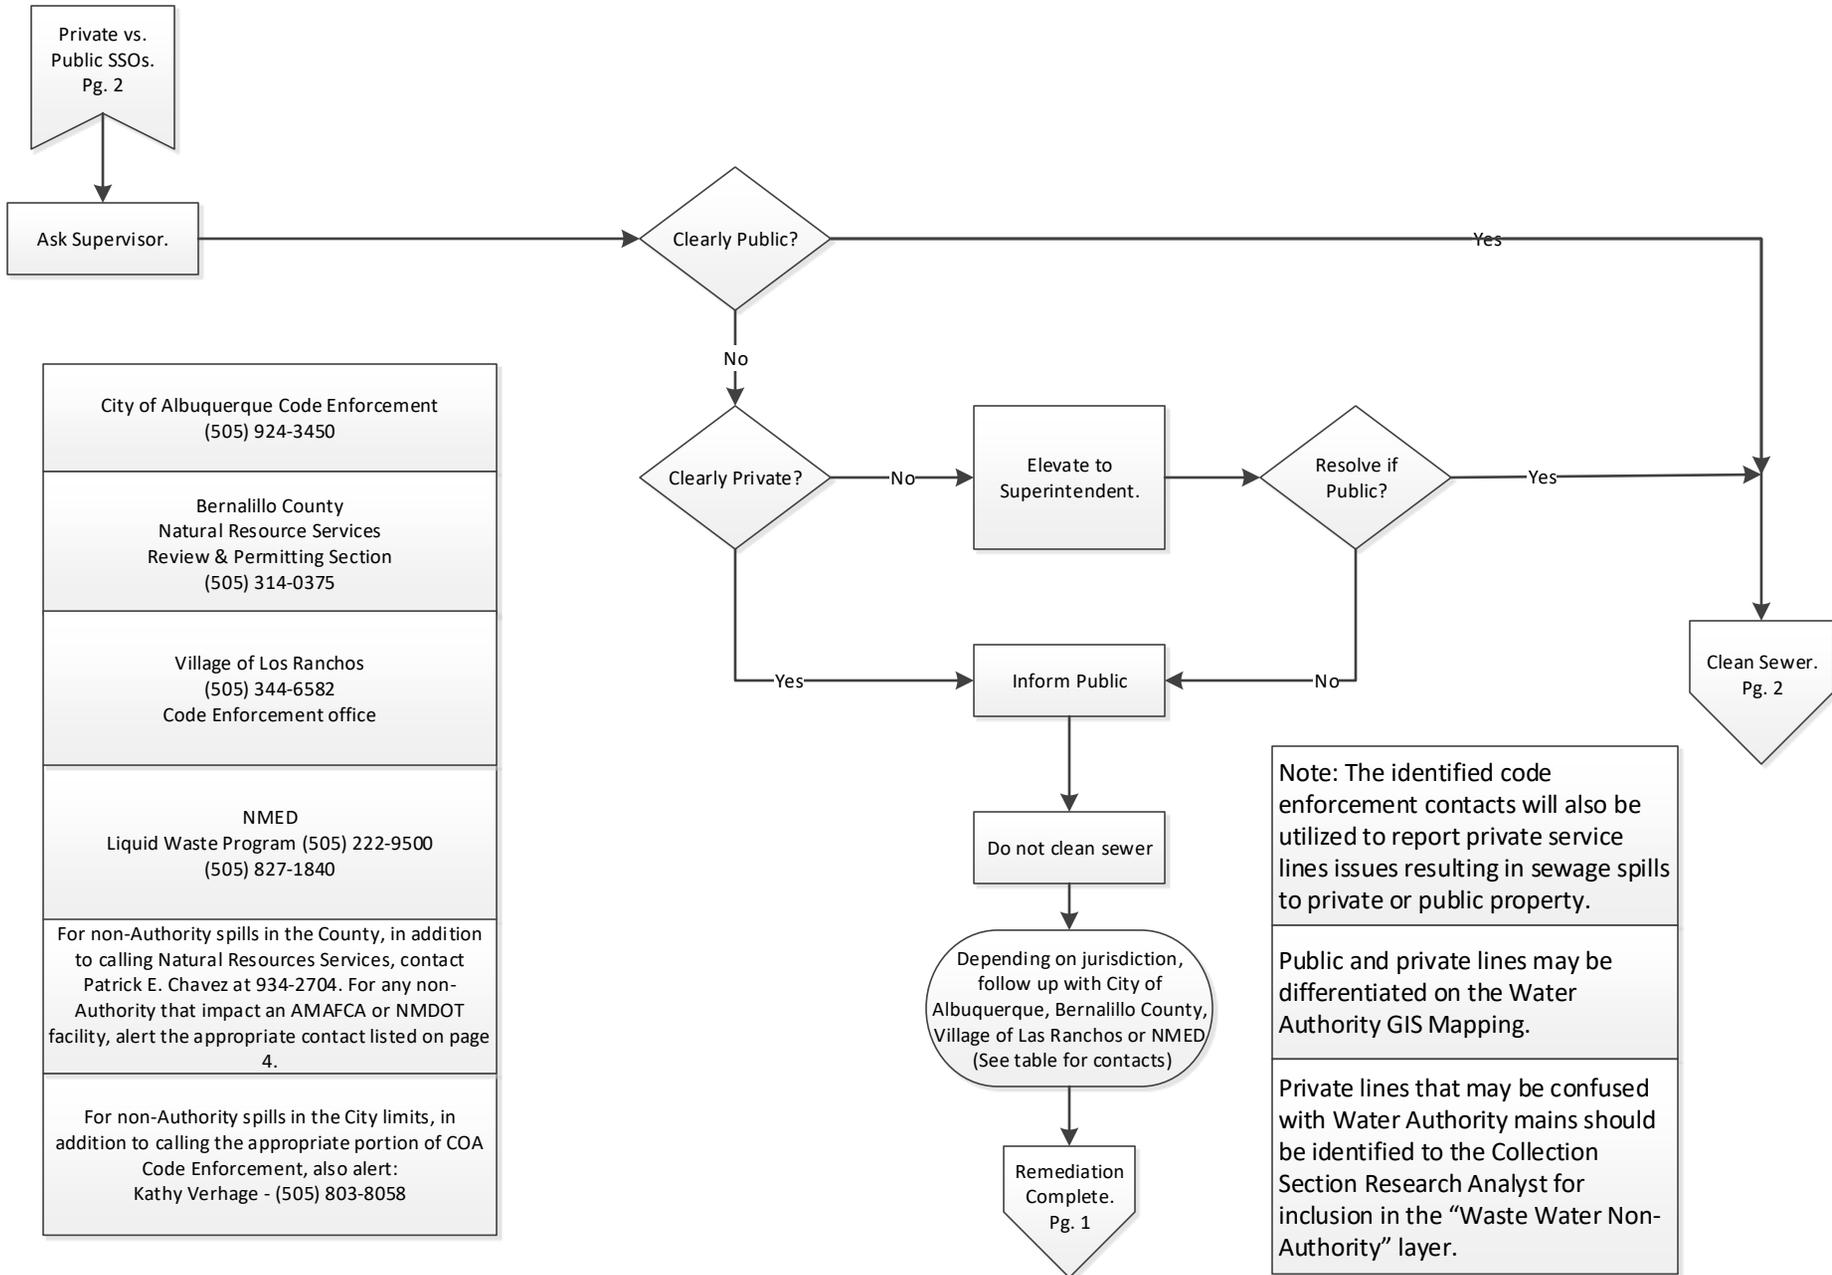

# Overflow Emergency Response Plan

12-1-2019

Albuquerque Bernalillo County Water Utility Authority

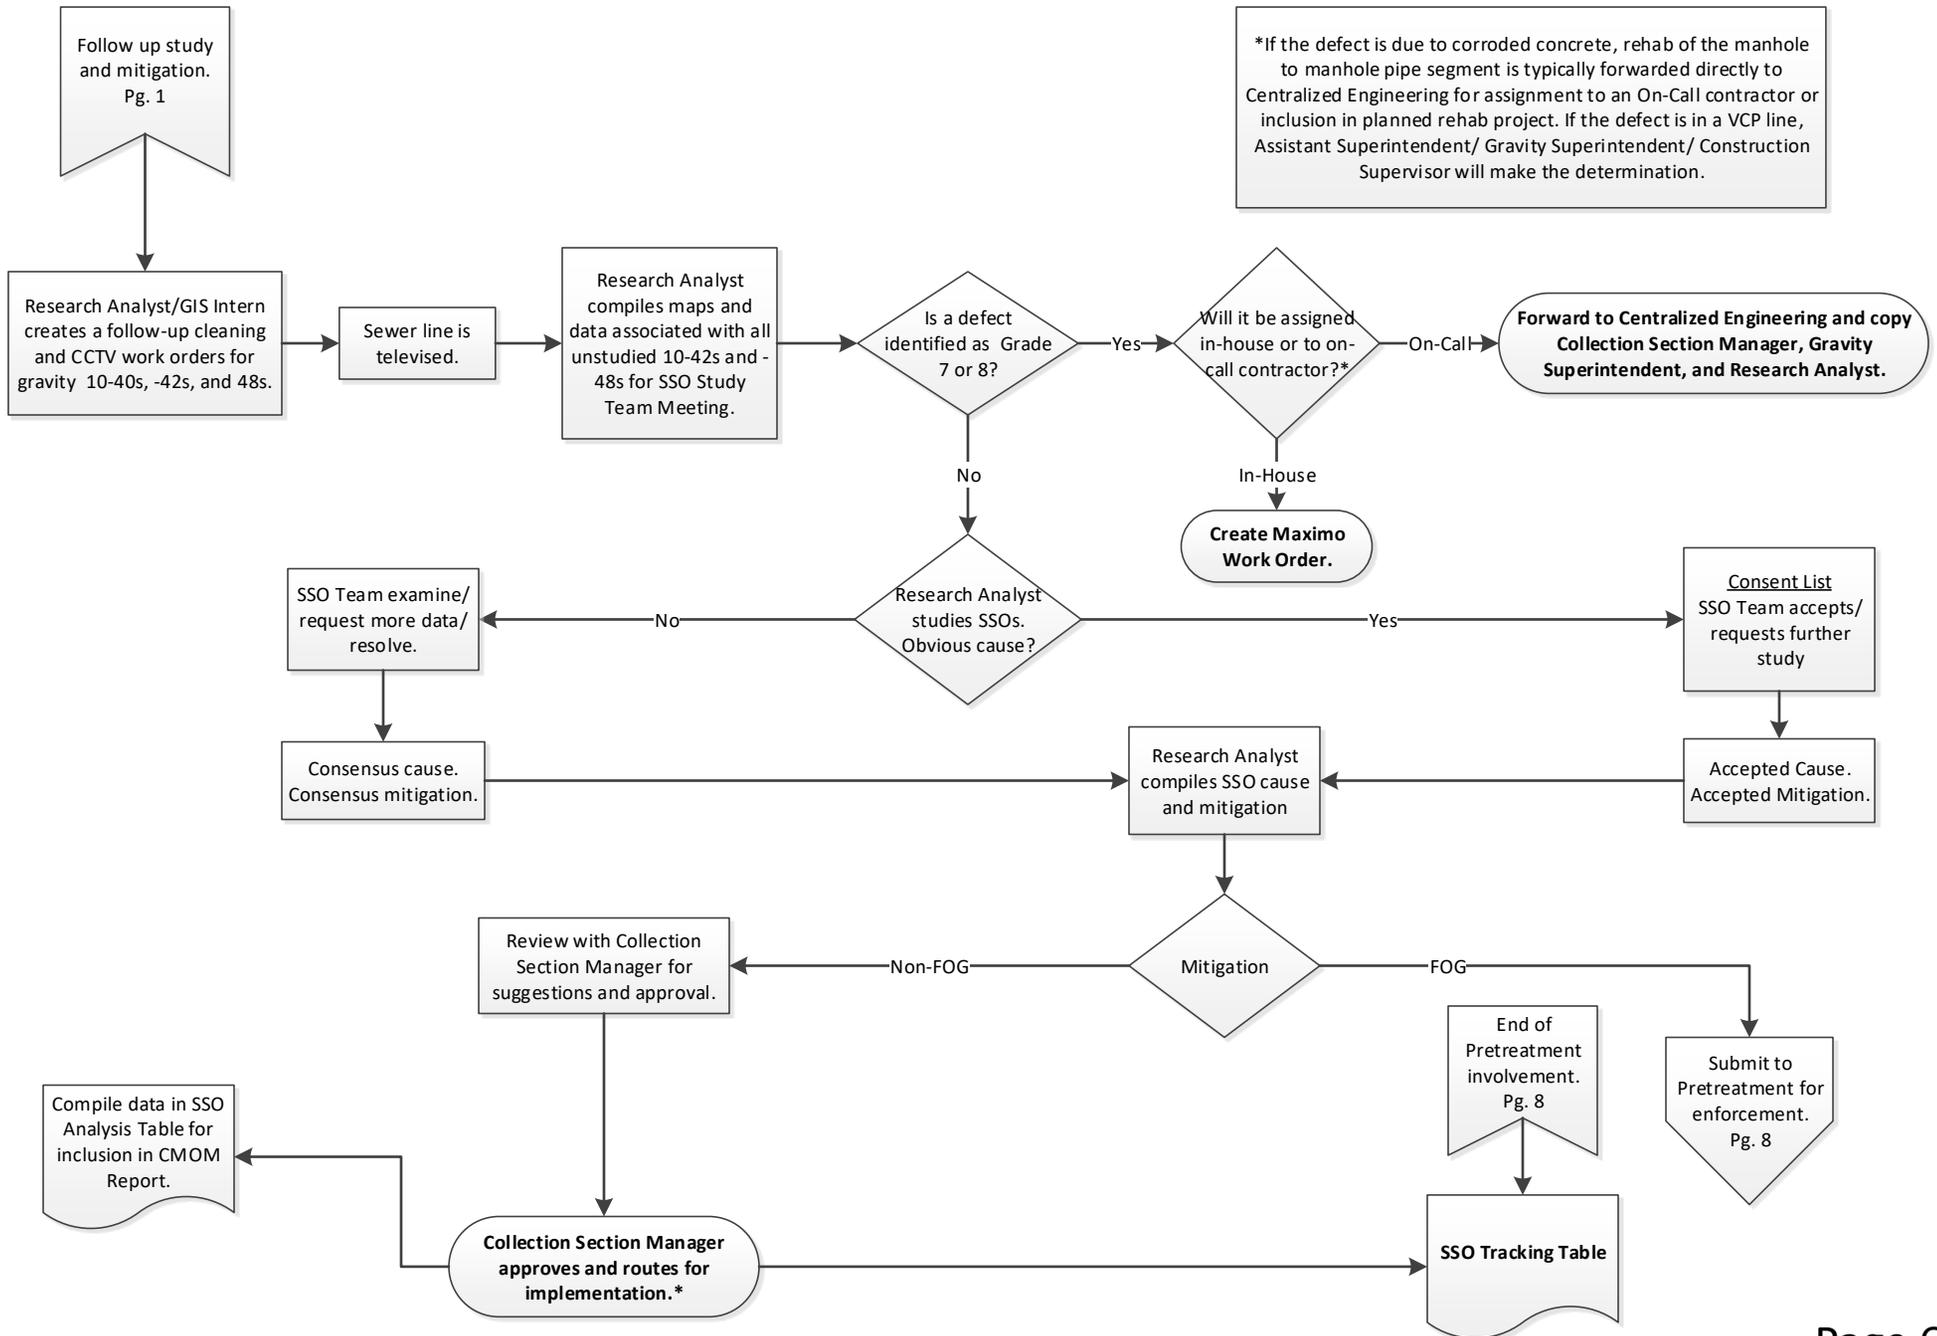


# Overflow Emergency Response Plan

12-1-2019

Albuquerque Bernalillo County Water Utility Authority


**GWQB Reporting**  
 Pondered sewage on a pervious area may require additional reporting to the Ground Water Quality Bureau (GWQB). Circumstances presumed to require this reporting will be:  
 1. A sewage spill that:  
 a. Is ponded for more than 24 hours and,  
 b. At a depth of more than 12 inches over an area of more than 0.1 acre.  
 The normal 24-hour call to NMED Surface Water is presumed to meet the requirement for a 24-hour notification to the GWQB. The Collection Section Manager shall be notified and shall be responsible for preparing the following additional reporting:  
 1. One week written report. Presumed the same as the five day report provided to NMED Surface Water.  
 2. 15-day Corrective Action Report.

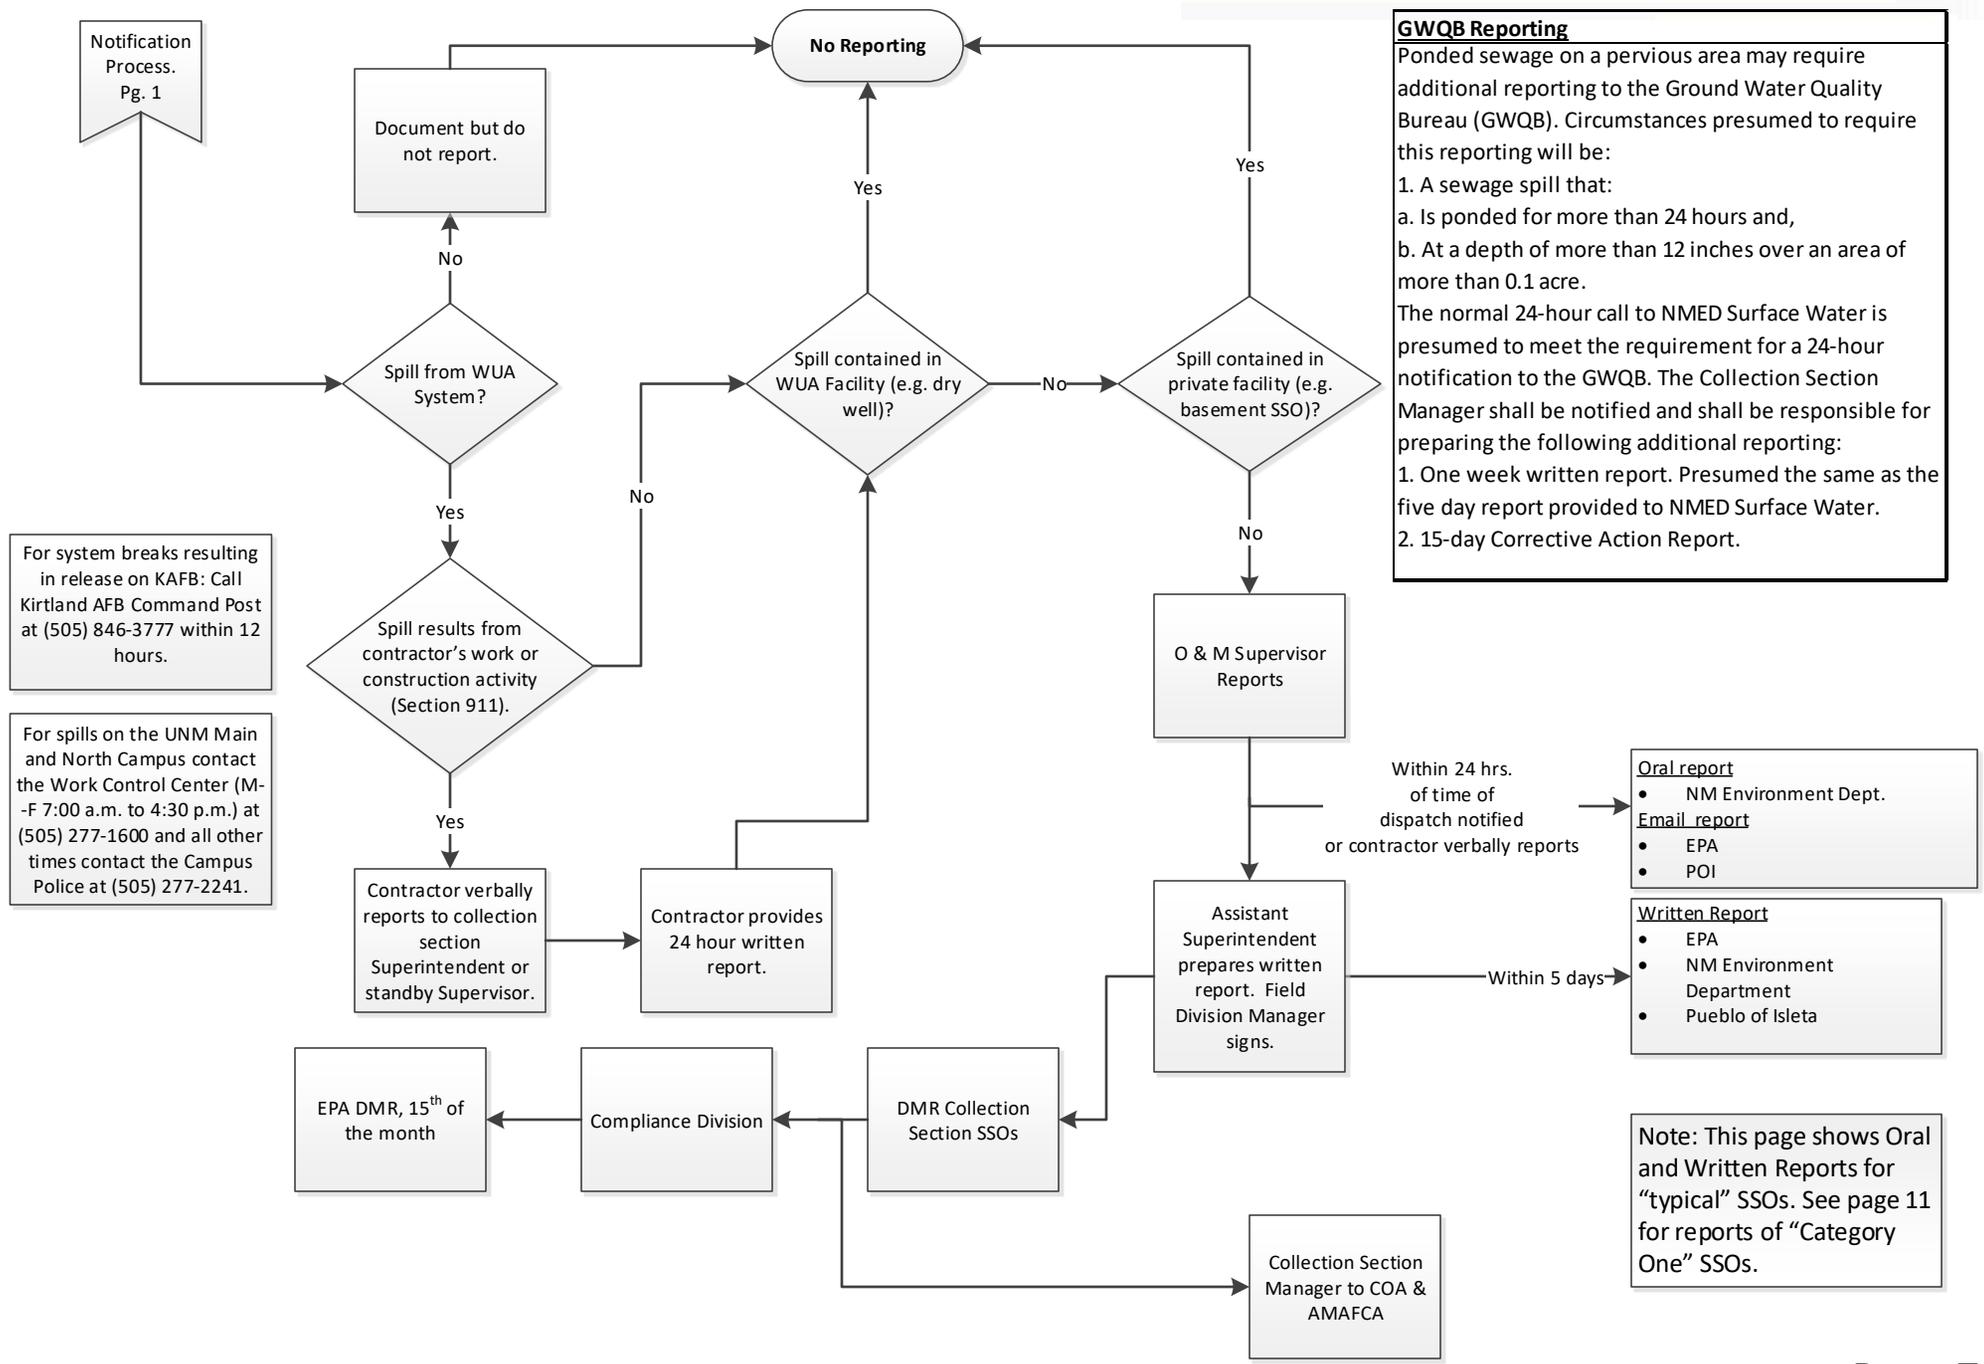


# Overflow Emergency Response Plan

12-1-2019

Albuquerque Bernalillo County Water Utility Authority

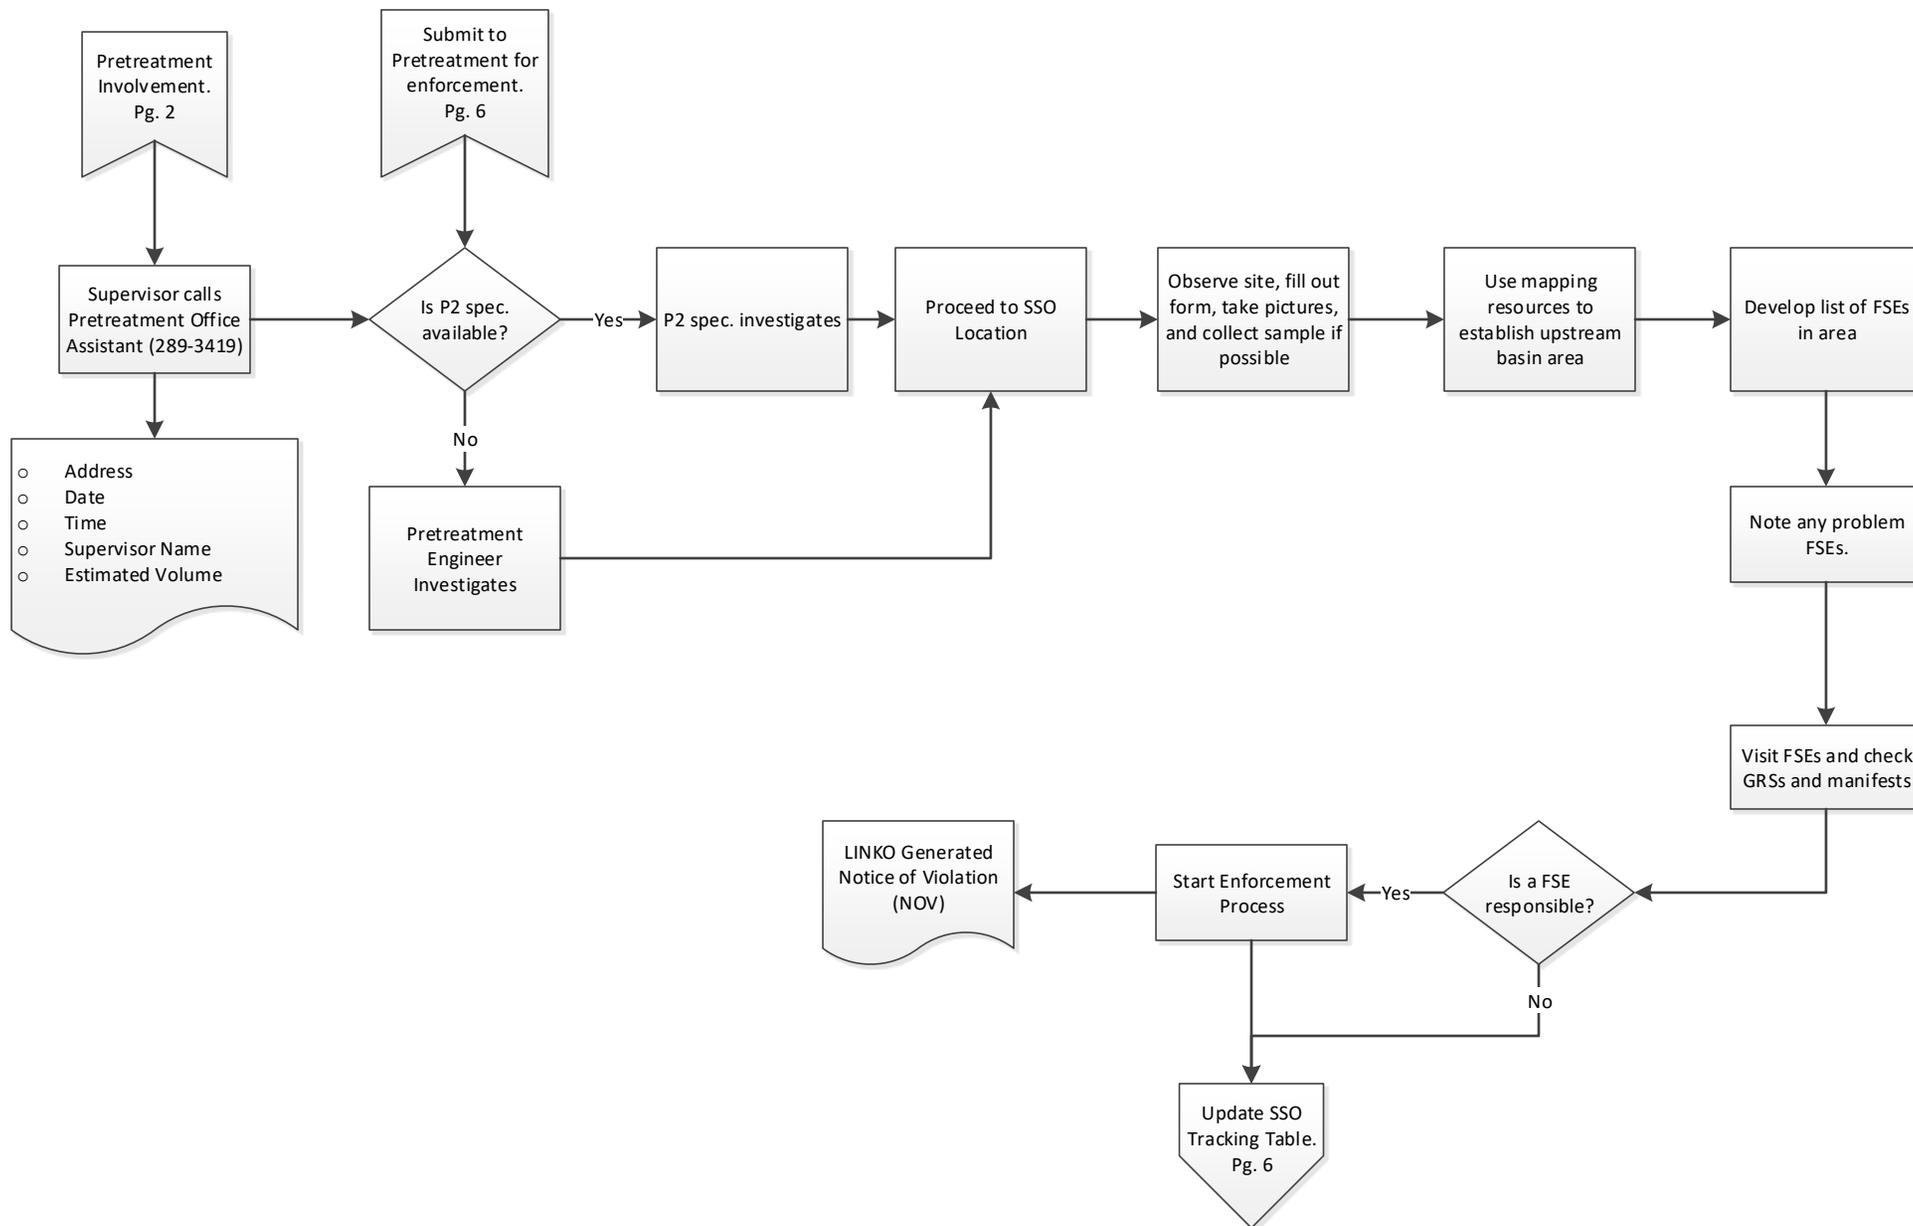

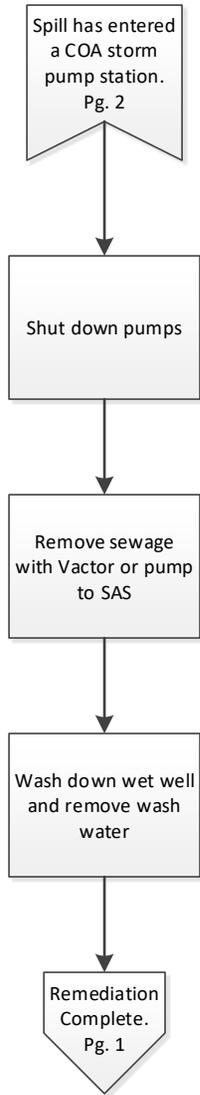

Note: Process shown is for typical spills. Some spills may require a joint response with the City of Albuquerque in which the spill is captured, treated, and determined appropriate for release.

